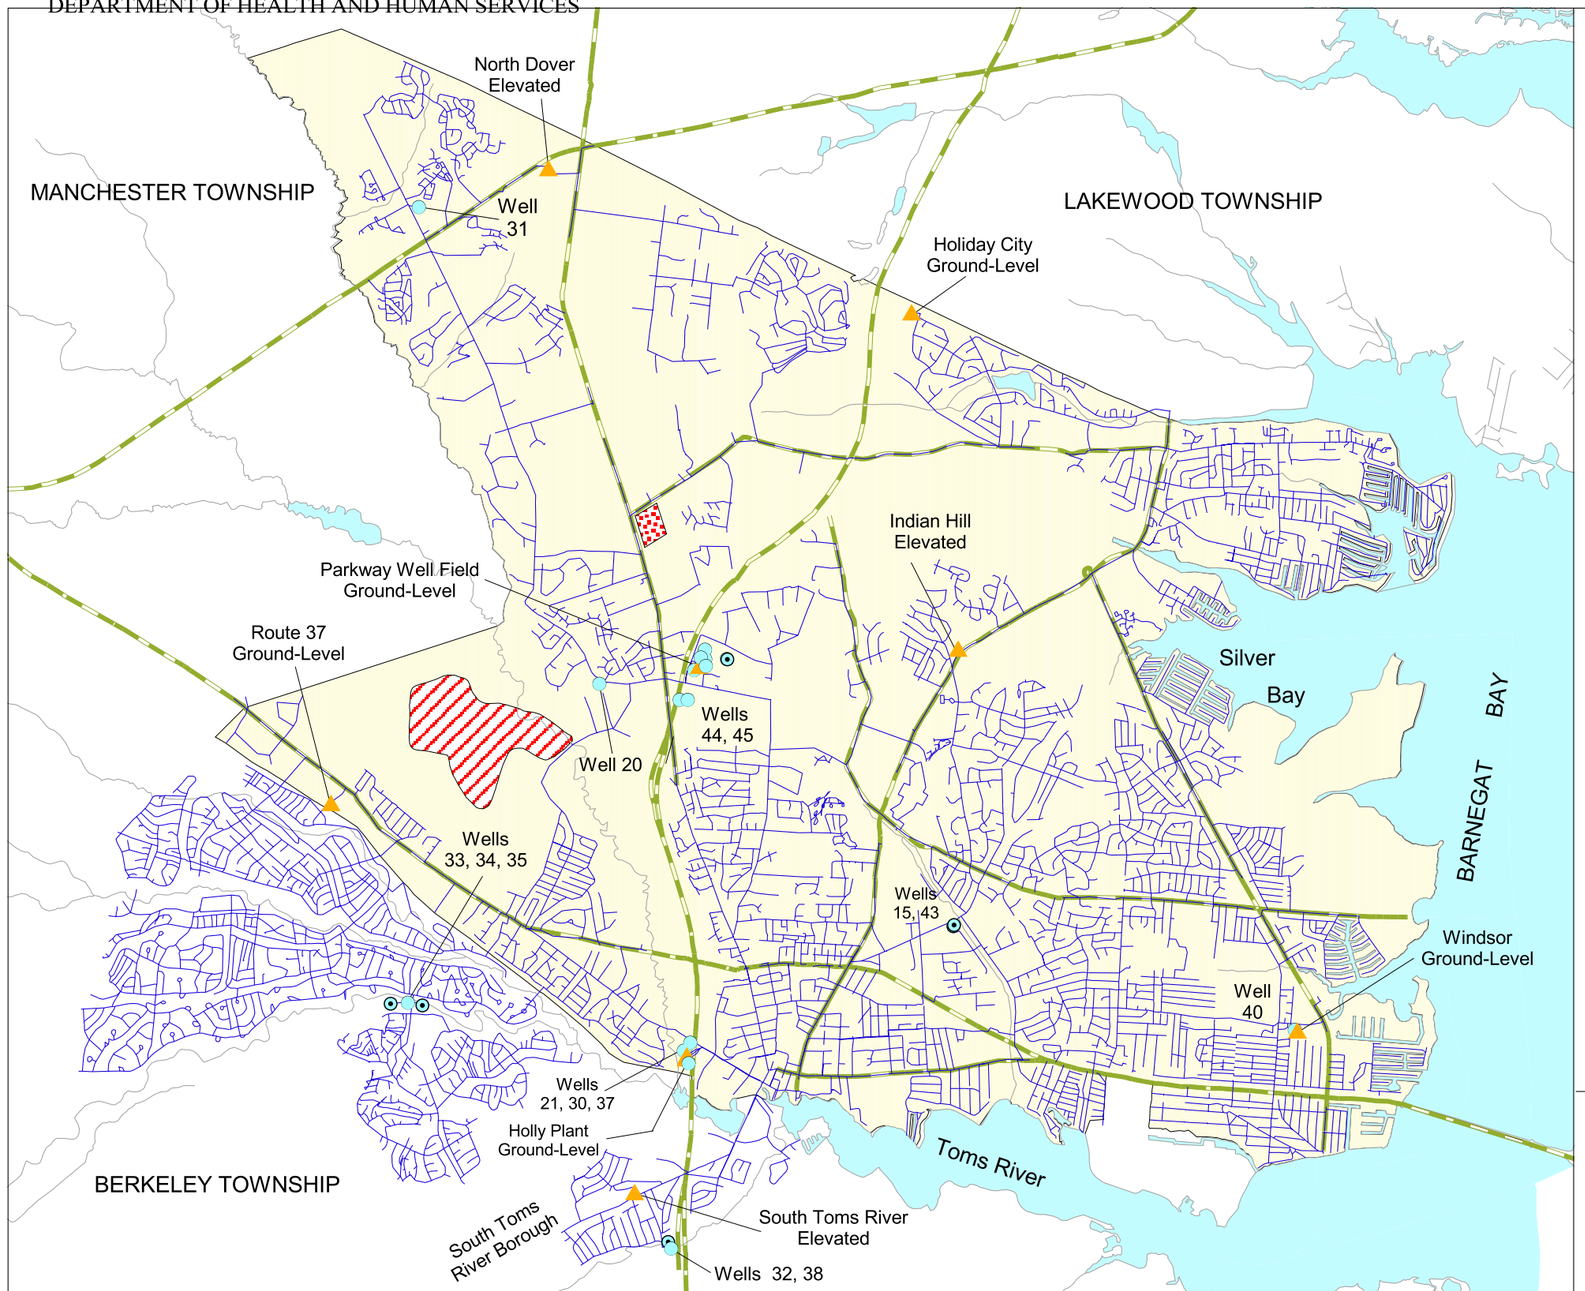

EXPLANATION

- Municipal Well
- Storage Tank
- Water Pipeline
- Major Road
- Hydrography
- Reich Farm NPL Site
- Ciba-Geigy NPL Site
- Dover Township
- Water Body

Note: Water pipelines range in diameter from 2 inches to 16 inches

0.5 0 0.5 1 1.5 2 2.5 Miles

N

ATSDR
AGENCY FOR TOXIC SUBSTANCES AND DISEASE REGISTRY

Dover Township Area, New Jersey
Water-Distribution System Model

Maslia ML, Sautner JB, Aral MM. 2000. Analysis of the 1998 water-distribution system serving the Dover Township area, New Jersey: field-data collection activities and water-distribution system modeling. Atlanta: Agency for Toxic Substances and Disease Registry, June 2000.

PLATE 2. WATER-DISTRIBUTION SYSTEM SERVING THE DOVER TOWNSHIP AREA, NEW JERSEY, 1998

By Morris L. Maslia, Jason B. Sautner, and Mustafa M. Aral